



ZIMBABWE ELECTRICITY TRANSMISSION & DISTRIBUTION COMPANY

HEAD OFFICE
ELECTRICITY CENTRE,
25 SAMORA MACHEL AVENUE,
HARARE
P.O. BOX 377, HARARE
TELEPHONE: 774491/9, 774508/35
FAX: 774542/3, 758356

OUR REF:..... FN/ec

YOUR REF

WHEN CALLING WITH REFERENCE
TO THIS LETTER PLEASE ASK FOR

..... F. Nyamakambo.....

06 October 2023

To All Bidders

Dear Sir/Madam

ADDENDUM NO. 1 TO THE SBD: MANDATORY SITE VISIT AND AMENDMENT OF CLAUSE 5.6.2, RATED NORMAL CURRENT FOR TENDER NO. ZETDC/INTER/06/2023 FOR THE SUPPLY, DELIVERY, INSTALLATION AND COMMISSIONING OF 20MVA, 132/88/11KV POWER TRANSFORMER AT GLENVILLE 88/11KV SUBSTATION


The above subject matter refers.

Attached herewith is **Addendum No. 1 to the Standard Bidding Document (SBD)** for Tender No. ZETDC/INTER/06/2023 for the Supply, Delivery, Installation and Commissioning of 20MVA, 132/88/11kV Power Transformer at Glenville 88/11kV Substation relating to details for inclusion of the **mandatory Site Visit under clause 1.7 on page 6 of 110 in the SBD and amendment of clause 5.6.2 Rated Normal Current on page 82 of 110 in the SBD.**

Yours faithfully

F. NYAMAKAMBO
SUPPLY CHAIN MANAGER

ZIMBABWE ELECTRICITY TRANSMISSION & DISTRIBUTION COMPANY

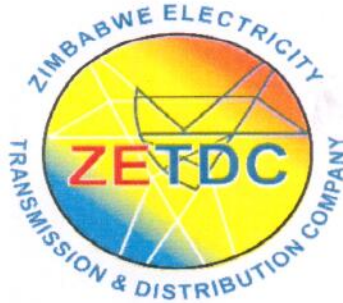

ADDENDUM NO. 1

**TO STANDARD BIDDING DOCUMENT (SBD) FOR
TENDER NO. ZETDC/INTER/06/2023**

**FOR THE SUPPLY, DELIVERY, INSTALLATION AND
COMMISSIONING OF 20MVA, 132/88/11KV POWER
TRANSFORMER AT GLENVILLE 88/11KV
SUBSTATION**

***(DETAILS FOR THE INCLUSION OF MANDATORY SITE VISIT & AMENDMENT OF CLAUSE
5.6.2 RATED NORMAL CURRENT ON PAGE 82 OF 110 IN THE STANDARD BIDDING
DOCUMENT)***

ADDENDUM NO. 1 TO STANDARD BIDDING DOCUMENT FOR TENDER NO. ZETDC/INTER/06/2023 FOR THE SUPPLY, DELIVERY, INSTALLATION AND COMMISSIONING OF 20MVA, 132/88/11KV POWER TRANSFORMER AT GLENVILLE 88/11KV SUBSTATION

Clause 1.7 on Page 6 of 110 in the Standard Bidding Document is hereby amended to read as follows:

1.7 Pre-bid meeting and Site Visit

This procurement requires **Mandatory Site Visit**. Mandatory Site Visit date is **02 November 2023 at 1000 hours at Glenville Substation, Bulawayo, Zimbabwe**. Bidders are required to submit security clearance application details to Procurement Management Unit or email procurement@zetdc.co.zw with details of bidder's representatives both local and foreign (not more than three (3) per bidder) under cover of a company letterhead. In the event that more than three (3) representatives are listed by the bidder, only the first three will be considered for security clearance application.

Note:

- (i) Individuals listed as **foreigners** should submit passport page with photo attached to the application letter on Bidder's company letterhead and **clearly state name, surname, Passport number, physical address/place of residence in Zimbabwe and contact/cellphone number**.
- (ii) Individuals listed as **locals** should **clearly state name, surname, National Identity number, physical address/place of residence in Zimbabwe and contact/cellphone number** on the application letter on Bidder's company letterhead.

Deadline for submission of Mandatory Site Visit Application letters with full names and identity details of bidder's representatives for both local and foreign bidders is **12 October 2023**. To attend and participate in the mandatory site visit, prospective bidders must first familiarize themselves with the Standard Bidding Document. A **Site Visit Certificate** shall be issued to bidders who would have attended the mandatory site visit. As receipt or movement of emails may be a challenge, it is the responsibility of the bidder to ensure that his/her security clearance application letter is received well on time for actioning by the Procuring Entity. No security clearance application letters will be considered after the deadline date neither are applications with relevant authorities done per individual company at different times.

N.B. On the day, there shall be only **one** meeting starting at 10:00 hours until closed. A Bidder's representative should ensure that he/she signs the Attendance Register at the time of mandatory site visit. Late comers shall not be entertained separately after the meeting is closed.

Failure to attend the mandatory Site Visit leads to automatic disqualification.



Clause 2.4.2 “**TECHNICAL SPECIFICATION FOR 11kV INDOOR SWITCHGEAR SINGLE BUSBAR**”

Clause 5.6.2 Rated Normal Current on page 82 of 110 in the Standard Bidding Document (SBD), is superseded by the following amendment:

5.6.2 Rated Normal Current

The rated normal current of the circuit breakers and busbars and connections shall not be less than the following:

	<u>11kV</u>
Three phase busbar and section	2000 Amps
Transformer	2000 Amps
Feeders	1600 Amps
All other HV connections	2000 Amps

Minimum short circuit current for the transformer incomer and bus section is 31.5kA and for feeders is 31.5kA

